


PLAN VIEW

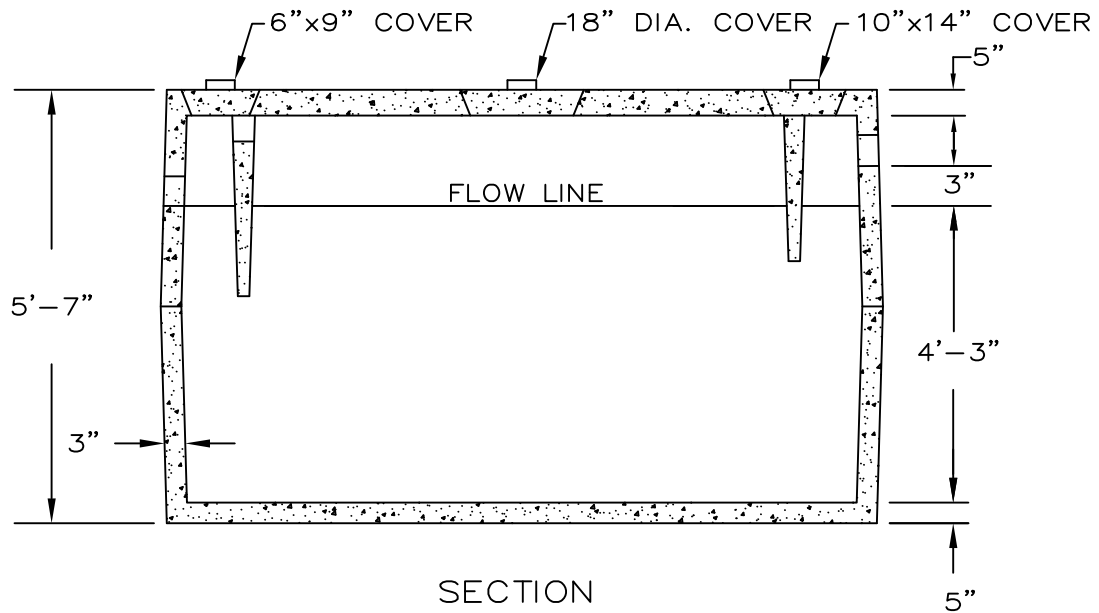

SECTION

NOTES :

- *CONCRETE TO TEST 4000 PSI AT 28 DAYS
- *STEEL REINFORCEMENT=6"x6"x10 GA. W.W.M.
- *CONSTRUCTION JOINT-SEALED WITH ASPHALT CEMENT OR EQUIVALENT.
- *9" ROOF SLAB AVAILABLE FOR H-20 LOADING.

Precast Concrete Sales Co.
 123 Route 303 Valley Cottage , N.Y. 10989
 Tel. (845) 268-4949 - Fax (845) 268-4376

CONT.		
JOB		
<i>1000 GALLON MID SEAM SEPTIC TANK</i>		
DATE	DRAWN BY	DRAWING NO.
1/16	CLASSIC DESIGN	5-1000-L