


PLAN VIEW

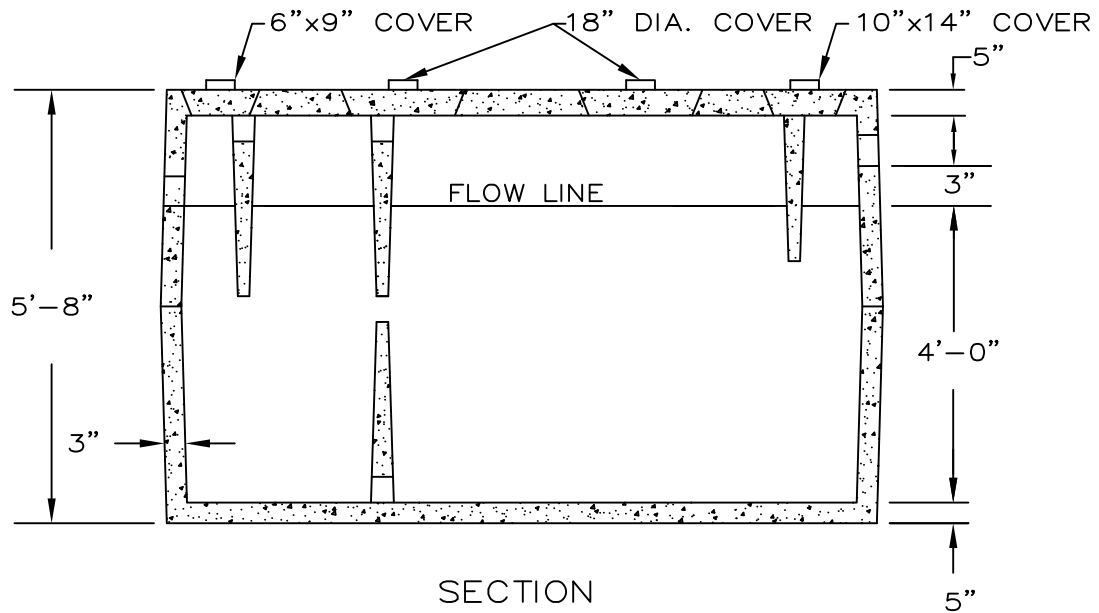

SECTION

NOTES :

- \*CONCRETE TO TEST 4000 PSI AT 28 DAYS
- \*STEEL REINFORCEMENT=6"x6"x10 GA. W.W.M.
- \*CONSTRUCTION JOINT-SEALED WITH ASPHALT CEMENT OR EQUIVALENT.
- \*9" ROOF SLAB AVAILABLE FOR H-20 LOADING.

Precast Concrete Sales Co.  
 123 Route 303 Valley Cottage , N.Y. 10989  
 Tel. (845) 268-4949 - Fax (845) 268-4376

CONT.		
JOB		
<i>1250 GALLON MID SEAM SEPTIC TANK</i>		
DATE	DRAWN BY	DRAWING NO.
1/16	CLASSIC DESIGN	5-1250-L