



PULLING IRONS  
(TYP. 4 LOCATIONS)

18"x18"x3' SUMP


8" x 8" K.O. OPENINGS  
TYPICAL (9 LOCATIONS)

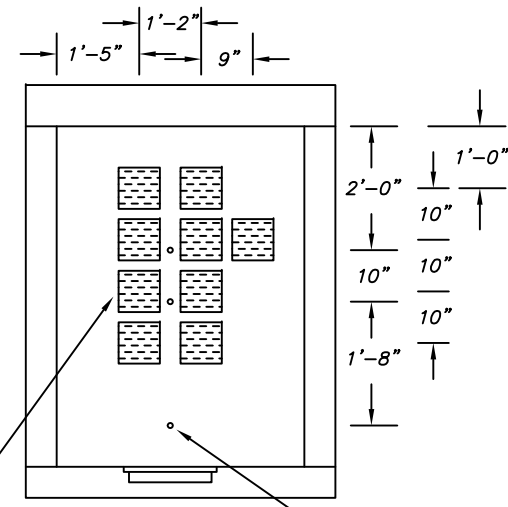

5/8" DIA. INSERTS

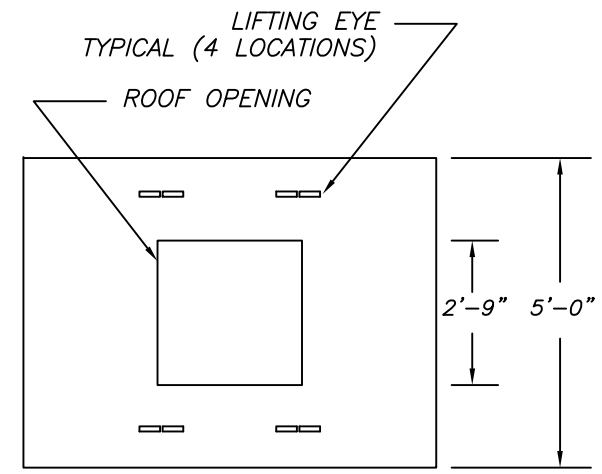


TOP SLAB PLAN VIEW

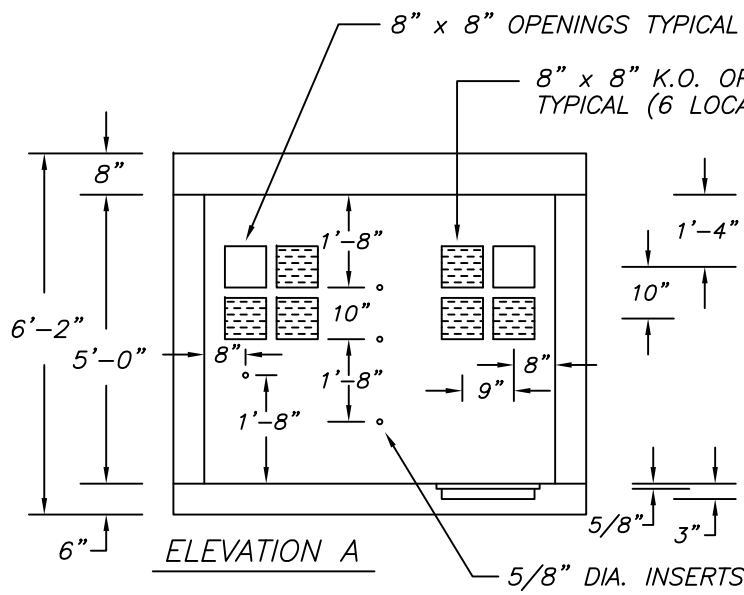


ELEVATION A

5/8" DIA. INSERTS (TYP.)

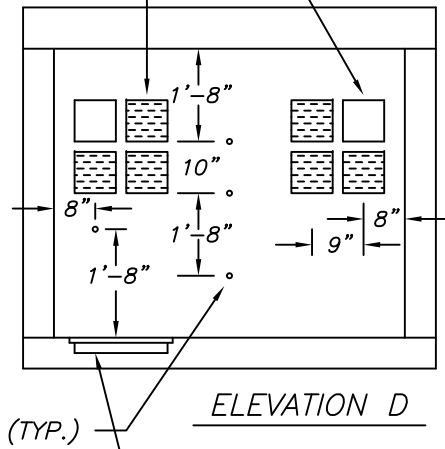

ELEVATION D

SUMP (TYP.)

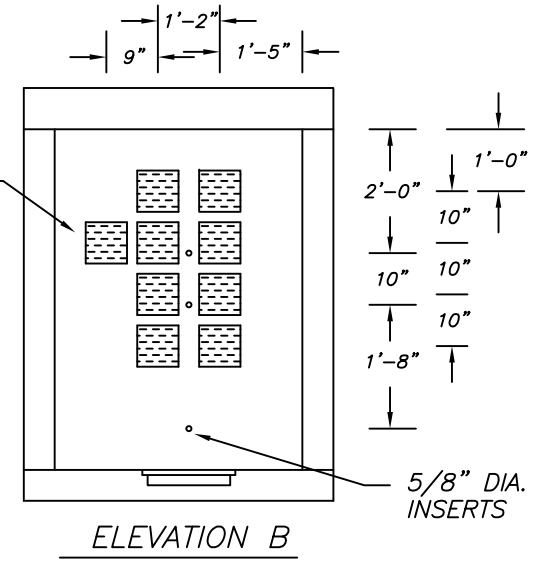

ELEVATION B

8" x 8" K.O. OPENINGS  
TYPICAL  
(9 LOCATIONS)

5/8" DIA. INSERTS

NOTES :  
 \* CONCRETE TO TEST 4000 PSI @ 28 DAYS  
 \* REFER TO CON ED DRAWINGS EO-12221-B & EO-13333-C FOR SPECIFIC DETAILS

(A) = SEE ELEVATION

Precast Concrete Sales Co.		
123 Route 303 Valley Cottage , N.Y. 10989		
Tel. (845) 268-4949 - Fax (845) 268-4376		
CONT.		
JOB		
CON ED DISTRIBUTION BOX TYPE DB-6 6'-0" x 4'-0" x 5'-0" ID		
DATE	DRAWN BY	DRAWING NO.
1/16	CLASSIC DESIGN	EO-13331 & 13333